
## GROUTED BROKEN CONCRETE RETAINING WALL

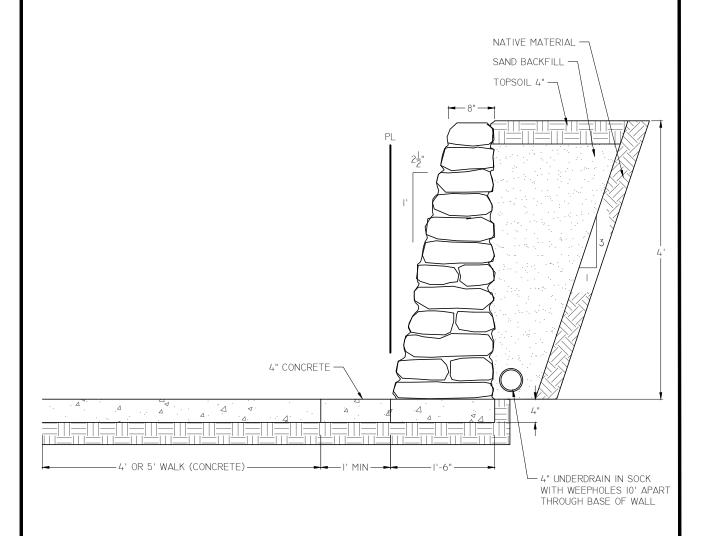

FOR A RETAINING WALL OF 2'-0" OR LESS IN HEIGHT, THE 4" CONCRETE FOOTING WILL NOT BE REQUIRED AND THE WIDTH OF THE BASE OF THE WALL MAY BE REDUCED TO A MINIMUM OF I'-0" WITH THE BASE EXTENDED TO A DEPTH OF 0'-6" BELOW THE TOP OF WALK.

WHERE THE HEIGHT OF THE RETAINING WALL IS GREATER THAN 4'-0", THE FOOTING AND BASE OF THE RETAINING WALL SHALL BE INCREASED  $2\frac{1}{2}$ " IN WIDTH FOR EVERY I'-0" OF ADDITIONAL HEIGHT.

## CITY OF WYOMING ENGINEERING DEPARTMENT

## GROUTED BROKEN CONCRETE RETAINING WALL

DRAWN BY - KJM	
CHECKED BY - JJ0	
DATE DRAWN - 3-2021	
DATE REVISED - 3-2021	

**I-29B**